


Mosaic™ Bulkhead light for skirting lighting

Cat. Nos) : 785 10



785 10

1. GENERAL CHARACTERISTICS


Bulkhead light for skirting lighting by LED.

2. RANGE


	Designation	Cat. No.	Number of modules	Fixing method	Connection method	Weight (g)	Characteristics
	Bulkhead light for skirting lighting	785 10	2	With clips	With screws	34	230 V~ 50/60 Hz

3. PREPARATION

The mechanisms can be flush-mounted or surface-mounted.
Modular mechanisms using adapter Cat. No. 802 99 (2 modules).
The mechanisms are mounted on thin walls using adapter Cat. No. 802 91 (2 modules).

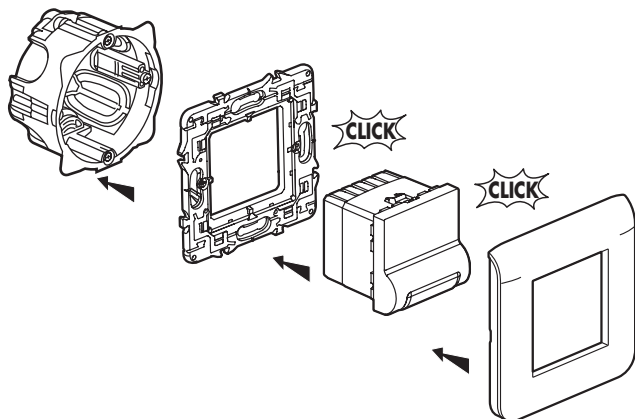


4. OVERALL DIMENSIONS

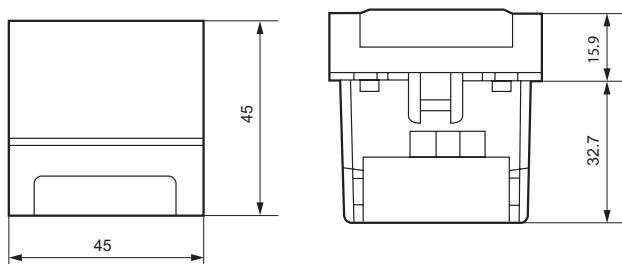

5. CONNECTION

Type of screwdriver : flat-blade screwdriver 3.5 mm or Philips No. 1 or posidrive No. 1 or mixed size 0.
Terminal capacities : 2.5 mm² or 2 x 1.5 mm²
Stripping length : 8 mm

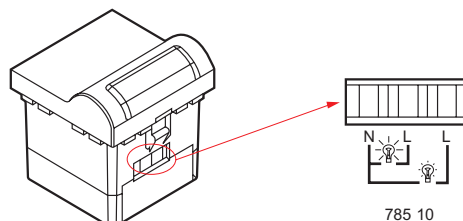

785 10

6. TECHNICAL CHARACTERISTICS

6.1 Technical characteristics

Impact tests : IK 04
Penetration by solid bodies/liquid : IP 41 (C15-100)

6.2 Material characteristics

Base : Polycarbonate
Cover plate : ABS (RAL 9003)

6.3 Electrical characteristics

Self-extinguishing : 650°C/30 s
Voltage : 230 V
Frequency 50/60 Hz

	1 W	0,2 W
Powers :		

6.4 Lighting levels

Measures taken at 30 cm from ground and 10 cm from wall :
- In high brightness position : 1700 cd/m²
- In low brightness position : 350 cd / m²

6.5 Climatic characteristics

Storage temperature : - 10°C to + 70°C
Operating temperature : - 5°C to + 50°C

Mosaic™

Bulkhead light for skirting lighting

Cat. No(s) : 785 10

7. CLEANING

Surface cleaning with a cloth.
Do not use : acetone, tar remover, trichloroethylene.

7.1 Resistance to cleaning agents

Resistance to the following agents : Hexane (EN 60669-1), Methylated spirits, Soapy water, Diluted ammonia, Diluted pure bleach 10%, Glass cleaning substance, Pre-impregnated wipes.

7.2 Resistance to hospital-type cleaning agents

Resistance to the following agents : Anios, Surfanios, Bactylsine, Diluted hydrogen peroxide (35%).

Caution : A preliminary test should be carried out if other specific cleaning products are to be used.

8. CONFORMITY - APPROVALS

Approvals in process : NF